


PLYMOUTH TWP DECK FORM

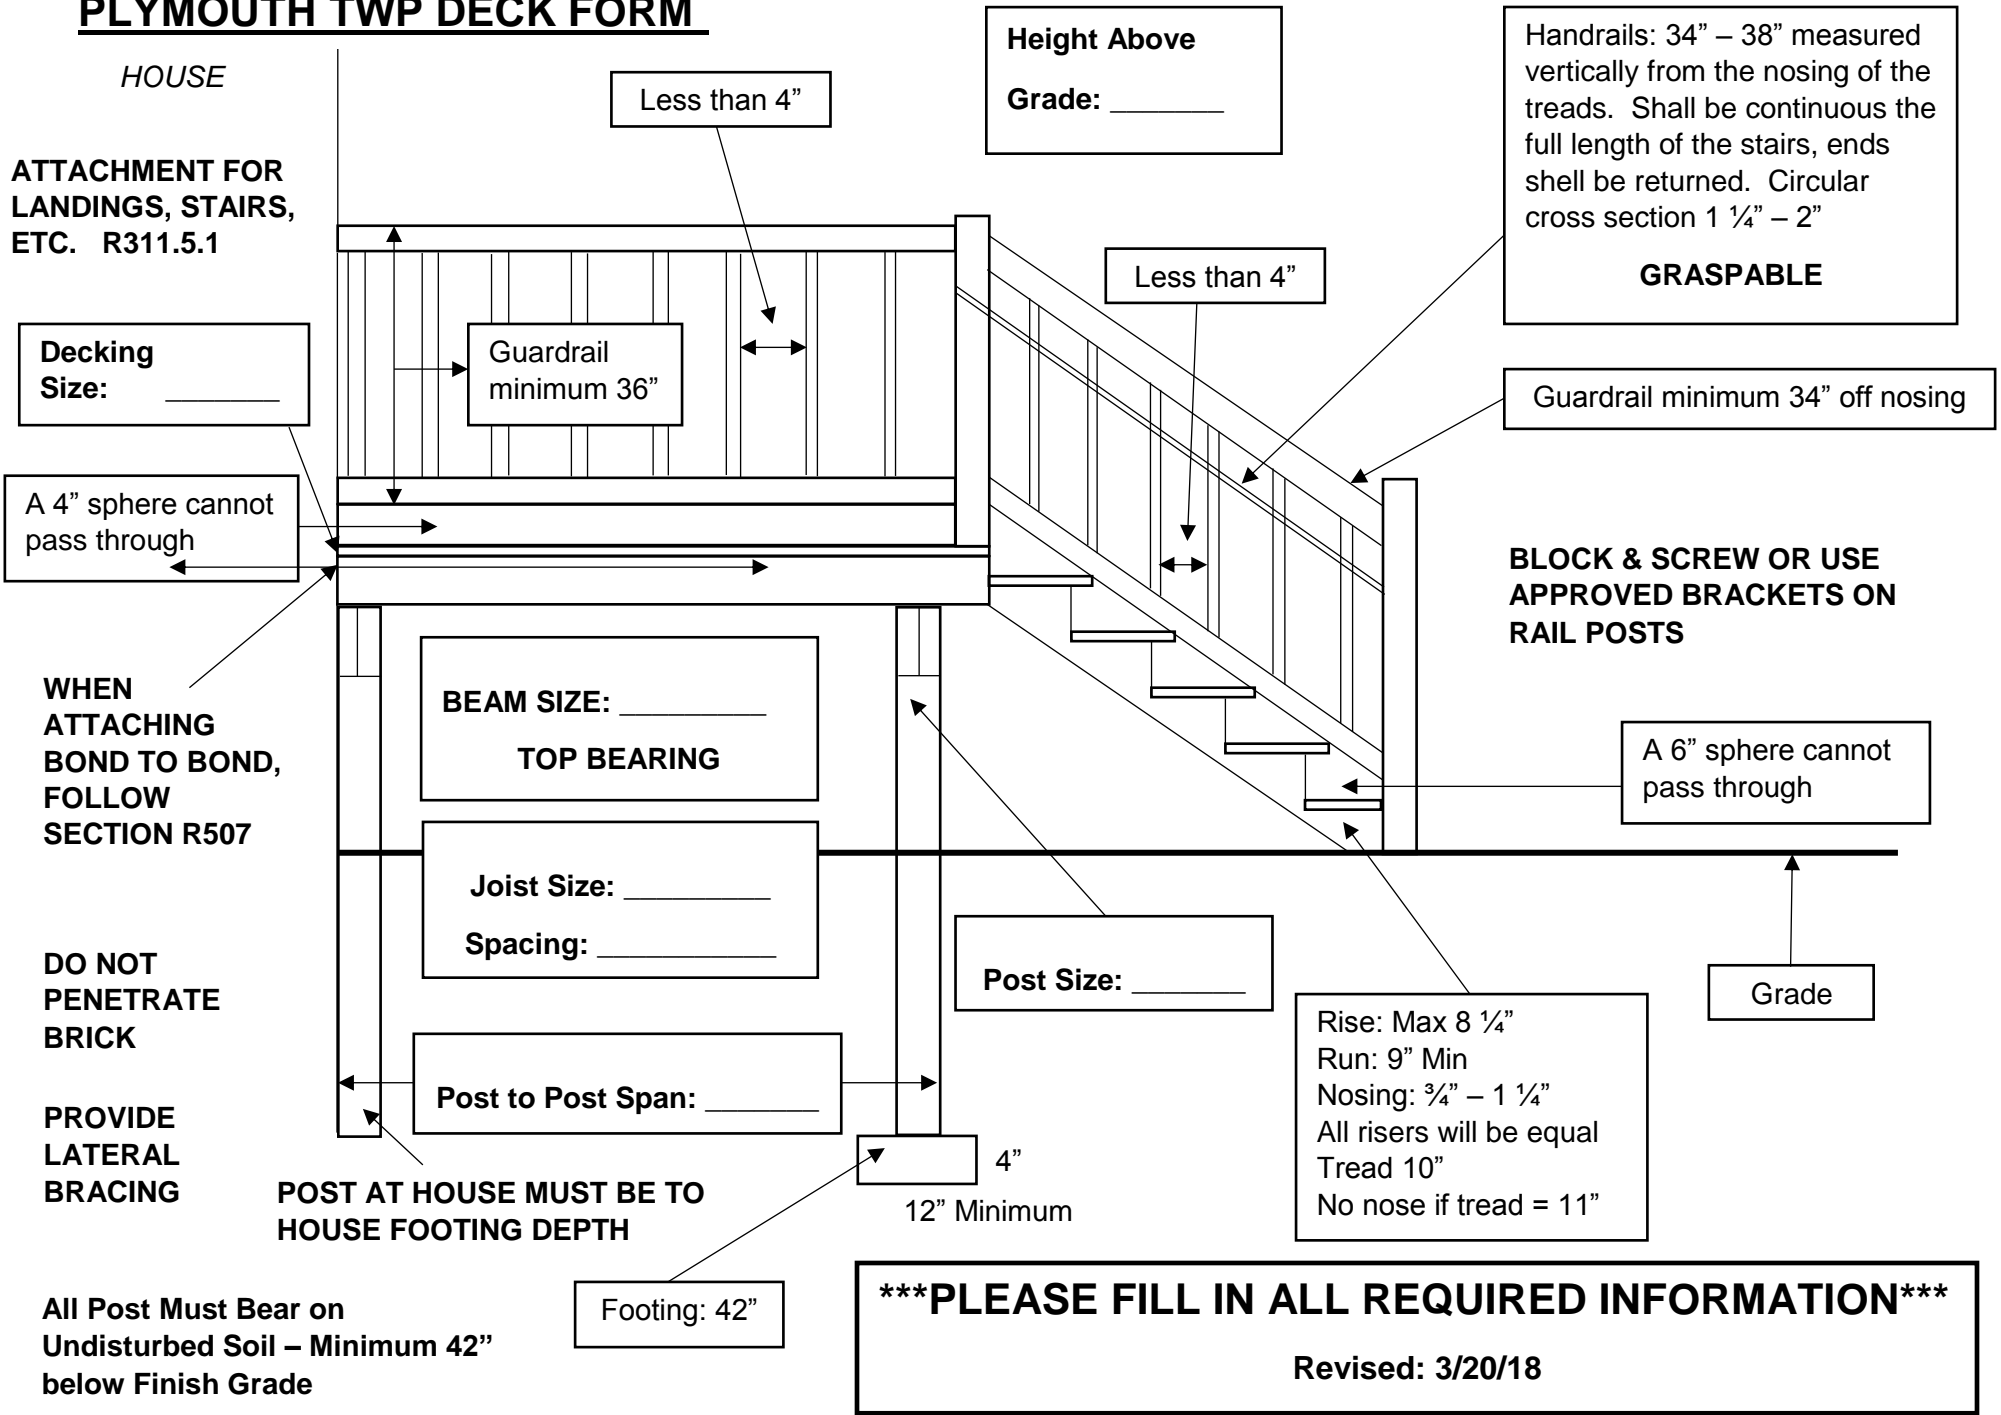

HOUSE

ATTACHMENT FOR
LANDINGS, STAIRS,
ETC. R311.5.1

Decking
Size: _____

A 4" sphere cannot
pass through

Less than 4"

Guardrail
minimum 36"

Height Above
Grade: _____

Handrails: 34" – 38" measured
vertically from the nosing of the
treads. Shall be continuous the
full length of the stairs, ends
shall be returned. Circular
cross section 1 1/4" – 2"
GRASPABLE

Less than 4"

Guardrail minimum 34" off nosing

**BLOCK & SCREW OR USE
APPROVED BRACKETS ON
RAIL POSTS**

WHEN
ATTACHING
BOND TO BOND,
FOLLOW
SECTION R507

BEAM SIZE: _____
TOP BEARING

A 6" sphere cannot
pass through

Joist Size: _____
Spacing: _____

DO NOT
PENETRATE
BRICK

Post Size: _____

Grade

PROVIDE
LATERAL
BRACING

Post to Post Span: _____

Rise: Max 8 1/4"
Run: 9" Min
Nosing: 3/4" – 1 1/4"
All risers will be equal
Tread 10"
No nose if tread = 11"

POST AT HOUSE MUST BE TO
HOUSE FOOTING DEPTH

4"
12" Minimum

All Post Must Bear on
Undisturbed Soil – Minimum 42"
below Finish Grade

Footing: 42"

*****PLEASE FILL IN ALL REQUIRED INFORMATION*****
Revised: 3/20/18

Beam/Post Connection Method and Hardware to be Used: _____